


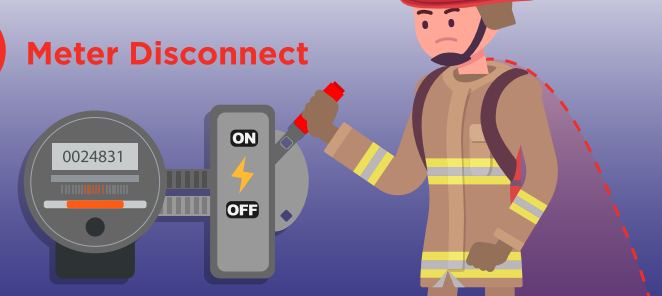


Not All Heroes Wear Capes

Home Emergency Power Disconnects


The codes and standard established by the **National Fire Protection Association** are the underlying systems that keep our homes and communities safe. **The National Electrical Code®**, which is updated every three years, provides the minimum standard for safe electrical installations.

Code Approved Emergency Disconnects

- 1 Service Disconnect** 
- 2 Meter Disconnect** 
- 3 Listed disconnect switches or circuit breakers on the supply side of each device disconnect suitable for use as service equipment.**

Arc-Fault Circuit Interrupters can Prevent Electrical Fires from Occurring

The National Electrical Code® **requires AFCI protection** for 15 and 20 amp circuits that serve outlets and devices in **all areas of new residential construction**, excluding bathrooms, garages, and outside areas. According to the CPSC, **AFCIs can prevent 50% of electrical fires.**

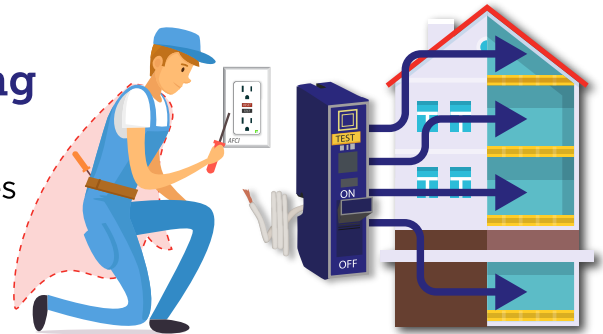

Section 230.85 of the 2020 National Electrical Code® requires homes to have outdoor emergency disconnects, allowing first responders to safely respond to emergencies without the risk of electrical hazards from the home.




- Test** smoke alarms monthly
- Change** battery yearly
- Replace** alarm every 10 years